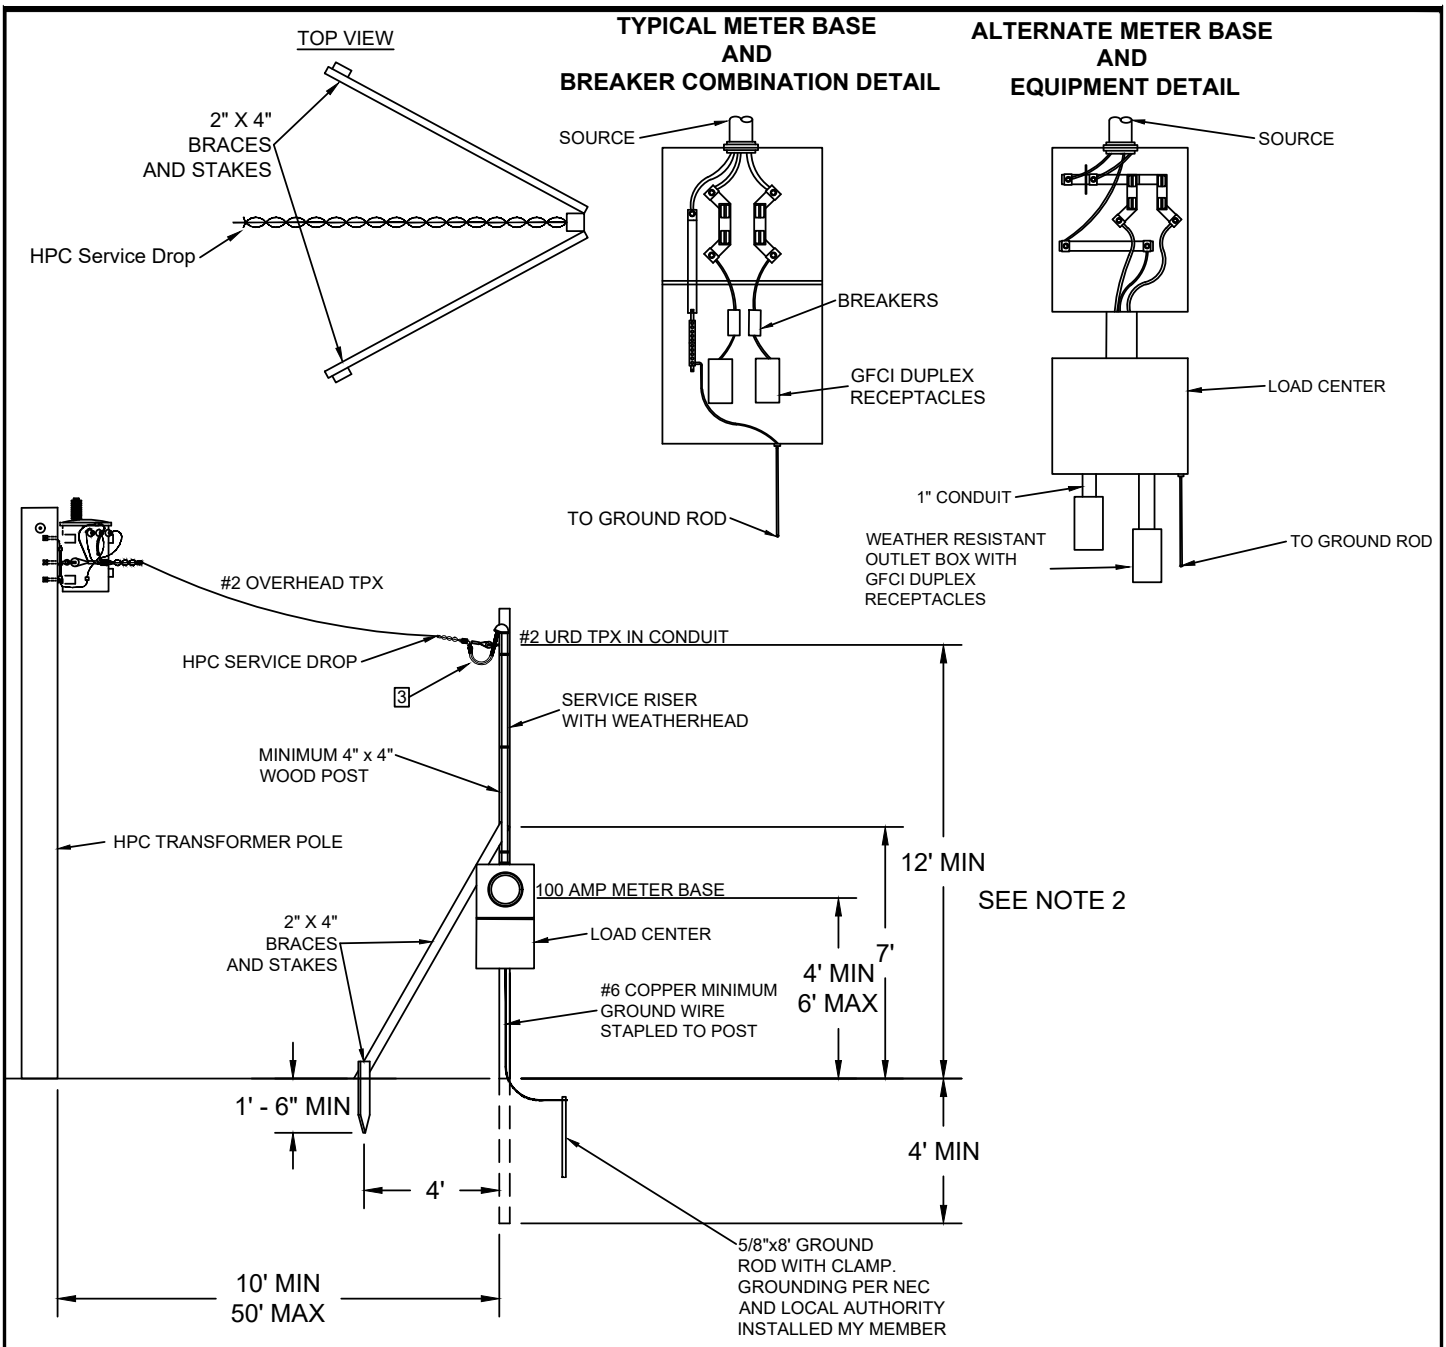



Notes:


1. Member to furnish and construct temporary structure with meter base and grounding.

2. All clearances shall conform to NEC, NESC, and other codes of governmental or regulating authorities as applicable. Residential service drop clearance may be reduced to 10' in areas restricted to pedestrian traffic only.


3. Member to provide 30" of excess triplex beyond the weatherhead for HPC to connect to service drop.


| TEMPORARY OVERHEAD SERVICE | |
|---|---|
| HENDRICKS POWER Cooperative<br>A Touchstone Energy® Cooperative | DEC 2023 |
| | SS1-45 |

**TYPICAL METER BASE AND BREAKER COMBINATION DETAIL**

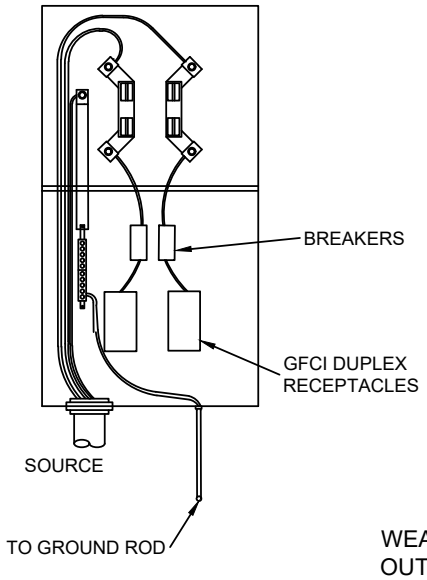


**ALTERNATE METER BASE AND EQUIPMENT DETAIL**

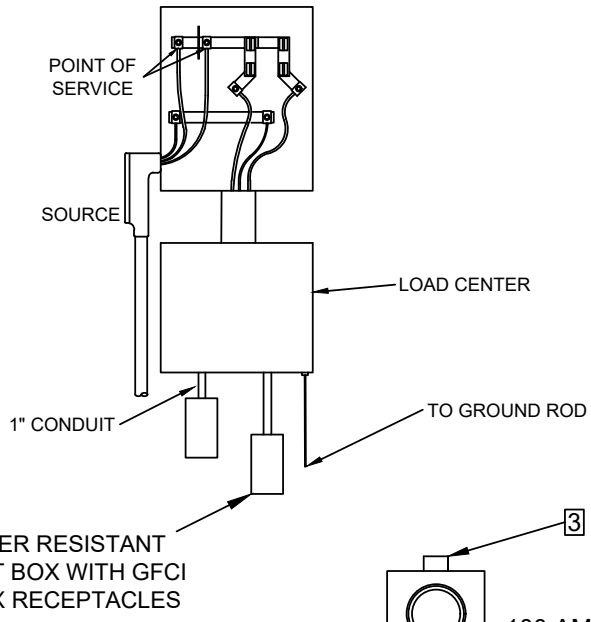

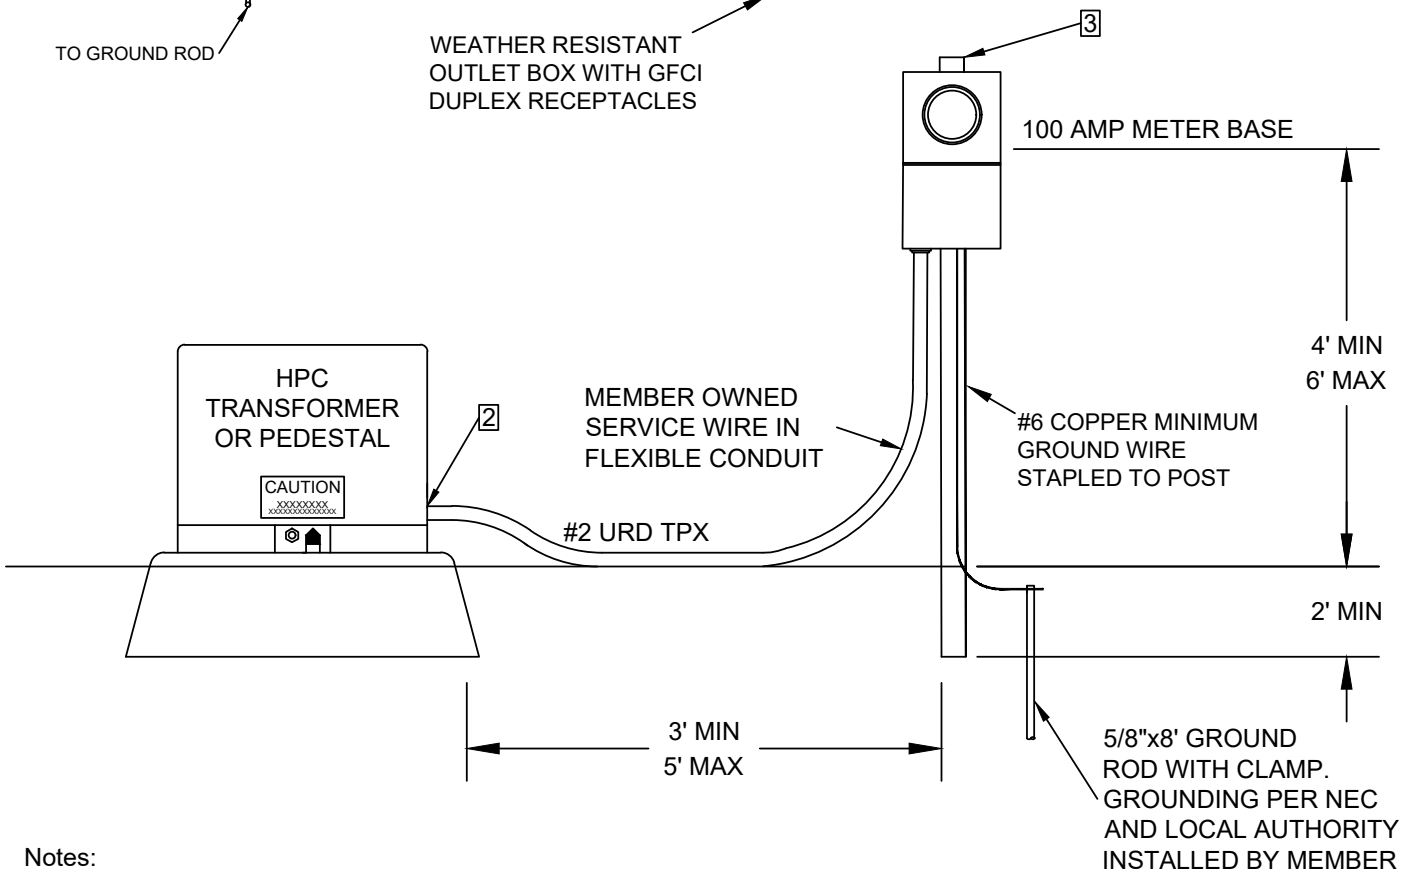
Notes:

1. Member to furnish and construct temporary structure with meter base and grounding.
2. Member to provide 1 1/4" conduit fittings and 3' of excess triplex for HPC to terminate inside of transformer or service pedestal
3. 4" x 4" Treated post with bracing as required.

| TEMPORARY UNDERGROUND SERVICE | |
|---|---|
| HENDRICKS POWER Cooperative<br>A Touchstone Energy® Cooperative | DEC 2023 |
| | SS1-46 |